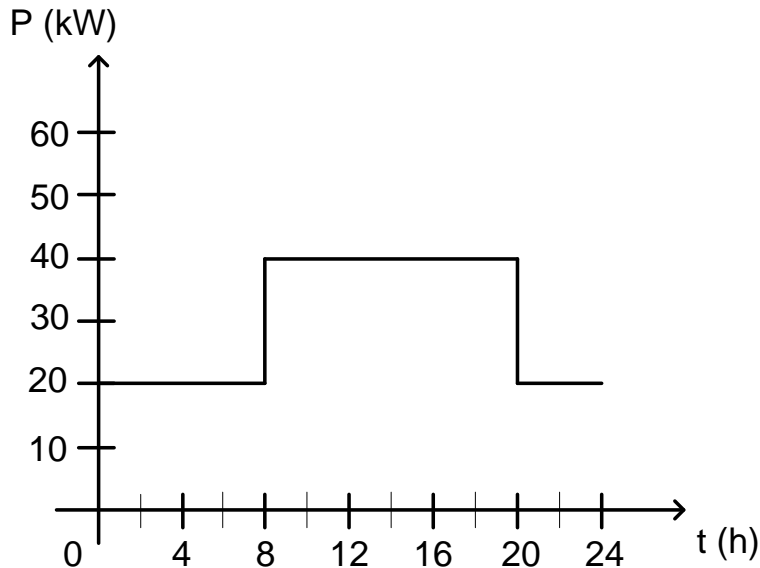


Example 1:

From the daily load profile determine consumed electric energy, maximal, average and minimal load, time of full loading and utilization time.

Solution:

Daily consumed energy:

$$W = \int_0^T P(t) \cdot dt = 20 \cdot 8 + 40 \cdot 12 + 20 \cdot 4 = 720 \text{ kWh}$$

Average, maximal and minimal load:

$$P_{avg} = \frac{W}{T} = \frac{720}{24} = 30 \text{ kW}$$

$$P_{max} = 40 \text{ kW}$$

$$P_{min} = 20 \text{ kW}$$

Time of full load:


$$\tau = \frac{W}{P_{max}} = \frac{720}{40} = 18 \text{ h}$$

Utilization time:

$$\tau_Z = \frac{\int_0^T P(t)^2 \cdot dt}{P_{max}^2} = \frac{20^2 \cdot 8 + 40^2 \cdot 12 + 20^2 \cdot 4}{40^2} = \frac{24\,000}{1\,600} = 15 \text{ h}$$

Example 2:

From the daily load profile determine consumed electric energy, maximal, average and minimal load, time of full loading and utilization time.

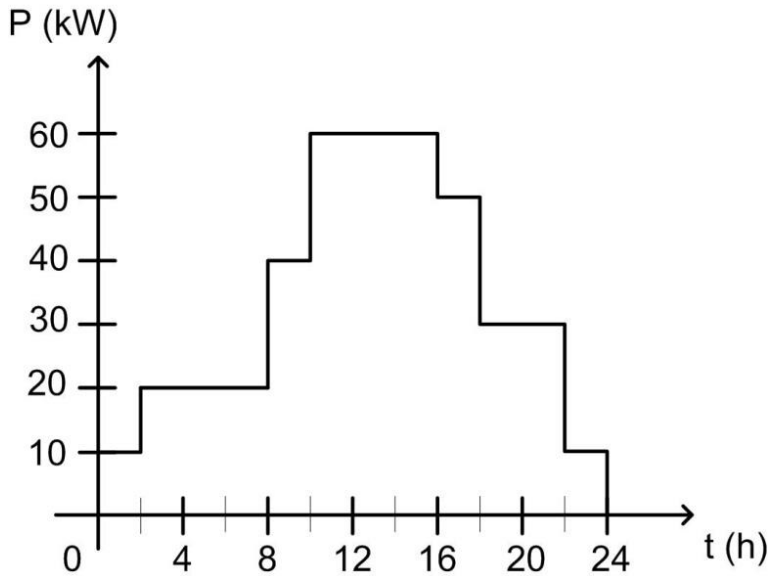Solution:

Daily consumed energy:

$$W = \int_0^T P(t) \cdot dt = 10 \cdot 2 + 20 \cdot 6 + 40 \cdot 2 + 60 \cdot 6 + 50 \cdot 2 + 30 \cdot 4 + 10 \cdot 2 = 820 \text{ kWh}$$

Average, maximal and minimal load:

$$P_{avg} = \frac{W}{T} = \frac{820}{24} = 34.2 \text{ kW}$$

$$P_{max} = 60 \text{ kW}$$

$$P_{min} = 10 \text{ kW}$$

Time of full load:

$$\tau = \frac{W}{P_{max}} = \frac{820}{60} = 13.7 \text{ h}$$

Utilization time:

$$\tau_z = \frac{\int_0^T P(t)^2 \cdot dt}{P_{max}^2} = \frac{10^2 \cdot 2 + 20^2 \cdot 6 + 40^2 \cdot 2 + 60^2 \cdot 6 + 50^2 \cdot 2 + 30^2 \cdot 4 + 10^2 \cdot 2}{60^2} = \frac{36\,200}{3\,600} = 10 \text{ h}$$

Example 3:

Hydroelectric power plant with installed power $P_{\text{ins}} = 85 \text{ MW}$ produces 180 GWh electric energy for each year. How are average value of power and time of installed power?

Solution:

Average value of power:


$$P_{\text{avg}} = \frac{W}{T} = \frac{180 \cdot 10^3}{365 \cdot 24} = 20.55 \text{ MW}$$

Time of installed power:

$$\tau = \frac{W}{P_{\text{max}}} = \frac{180 \cdot 10^3}{85} = 2117.65 \text{ h} \approx 88.24 \text{ days}$$

Example 4:

Determine economically effective distribution of load in electrical power system according to figure. Neglect losses.

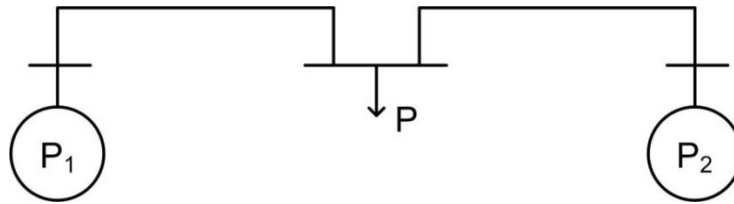

Average increments of costs are given by :

$$b_1 = 4 + 0,25 \cdot P_1 + 0,005 \cdot P_1^2$$

$$b_2 = 3 + 0,12 \cdot P_2 + 0,003 \cdot P_2^2$$

Total load of power system $P = 90$ MW.

Solution:

The condition of economically effective distribution of load will be fulfilled if $b_1 = b_2$ and $\varphi = P_1 + P_2 - P = 0$

The P_2 can be then expressed as:

$$P_2 = P - P_1$$

And from the substitution to the equation $b_1 = b_2$ we can get:

$$4 + 0,25 \cdot P_1 + 0,005 \cdot P_1^2 = 3 + 0,12 \cdot (P - P_1) + 0,003 \cdot (P - P_1)^2$$

After rearrangement of the equation:

$$4 + 0,25 \cdot P_1 + 0,005 \cdot P_1^2 = 3 + 0,12 \cdot P - 0,12 \cdot P_1 + 0,003 \cdot P^2 - 0,006 \cdot P \cdot P_1 + 0,003 \cdot P_1^2$$

The final form is quadratic equation:

$$0,002 \cdot P_1^2 + 0,91 \cdot P_1 - 34,1 = 0$$

By solving this equation the effective loading of first power plant can be determined:

$$P_1 = \frac{-0,91 + \sqrt{0,91^2 + 4 \cdot 0,002 \cdot 34,1}}{2 \cdot 0,002} = 34,84 \text{ MW}$$

The loading of second power plant is then:

$$P_2 = P - P_1 = 90 - 34,84 = 55,16 \text{ MW}$$

The check, whether the calculation is correct:

$$b_1 = 4 + 0,25 \cdot 34,84 + 0,005 \cdot 34,84^2 = 18,74$$

$$b_2 = 3 + 0,12 \cdot 55,16 + 0,003 \cdot 55,16^2 = 18,74$$